




ORIGINAL INSTRUCTIONS

Instruction Manual
High Precision Digital Pressure Switch
ISE79S

IO-Link



The intended use of the pressure switch is to measure the pressure of fluid and to provide an output signal.

1 Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of "Caution," "Warning" or "Danger." They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC) ⁽¹⁾, and other safety regulations.

⁽¹⁾ISO 4414: Pneumatic fluid power - General rules and safety requirements for systems and their components.
ISO 4413: Hydraulic fluid power - General rules and safety requirements for systems and their components.
IEC 60204-1: Safety of machinery - Electrical equipment of machines. Part 1: General requirements.
ISO 10218-1: Robotics - Safety requirements - Part 1: Industrial robots.

- Refer to product catalogue, Operation Manual and Handling Precautions for SMC Products for additional information.
- Keep this manual in a safe place for future reference.

	Danger	Danger indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.
	Warning	Warning indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.
	Caution	Caution indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

Warning

- Always ensure compliance with relevant safety laws and standards.**
- All work must be carried out in a safe manner by a qualified person in compliance with applicable national regulations.
- This product is class A equipment intended for use in an industrial environment. There may be potential difficulties in ensuring electromagnetic compatibility in other environments due to conducted or radiated disturbances.
- Do not disassemble, modify (including changing the printed circuit board) or repair.**
An injury or failure can result.
- Do not operate the product outside of the specifications.**
Do not use for flammable or harmful fluids.
Fire, malfunction or damage to the product can result.
- Do not operate in an atmosphere containing flammable or explosive gases.**
Fire or an explosion can result.
This product is not designed to be explosion proof.
- If using the product in an interlocking circuit:**
Provide a double interlocking system, for example a mechanical system.
- Check the product for correct operation.**
Otherwise malfunction can result, causing an accident.
- Do not touch terminals and connectors while the power is on.**
Otherwise electric shock, malfunction or product damage can result.
- Refer to the operation manual on the SMC website (URL: <https://www.smcworld.com>) for more safety instructions.

2 Specifications

2.1 General specifications

Product No.		ISE79S
Applicable fluid		Fluids and Gases (non corrosive)
Pressure	Rated pressure range	0 to 50.0 MPa
	Display / set pressure range	-2.5 to 52.5 MPa
	Minimum setting unit	0.1 MPa
	Proof pressure	75 MPa
Electrical	Power supply as switch output device	12 to 24 VDC ±10% with 10% Voltage ripple or less (p-p)
	Power supply as IO-Link device	18 to 30 VDC, including 10% voltage ripple (p-p)
	Current consumption	35 mA or less
	Protection	Polarity protection
Accuracy	Display accuracy	±2% F.S.±1 digit (at ambient 25±3 °C)
	Repeatability	±0.5% F.S.
	Temp. characteristics (25 °C standard)	±5% F.S.
Switch output	Output type	NPN or PNP open collector output.
	Output mode	Hysteresis mode, window comparator mode, error or switch output OFF.
	Switch operation	Normal or reversed output.
	Max. Load current	80 mA
	Max. Applied voltage	30 V (NPN output)
	Internal voltage drop (Residual voltage)	1.5 V or less (Load current 80 mA)
	Delay time	2.0 ms or less (for anti-chatter function: variable at 0 to 60 s / 0.01 step)
	Hysteresis or Window comparator mode	Variable from 0
	Circuit protection	Short circuit protection
	Display	Units
Display type		LCD
Number of displays		3-screen display (Main display, sub display x 2)
Display colour		Main display: Red/Green, Sub display: Orange
Number of display digits		Main display: 4 digits (7-segments) Sub display: 4 digits (Upper 1 digit 11-segments, 7-segments for other)
Operation light		LED is ON when switch output is ON (OUT1, OUT2: Orange)
Digital filter		Variable from 0 to 30 s / 0.01 step
Environment	Enclosure	IP67
	Withstand voltage	500 VAC for 1 minute between terminals and housing
	Insulation resistance	1000 MΩ or more between terminals and housing (with 50 VDC megger)
	Fluid temperature	-5 to 70 °C (no condensation or freezing)
	Ambient temperature	Operation: -5 to 50 °C, Storage: -10 to 60 °C (no condensation or freezing)
	Humidity	Operation, Storage: 35 to 85%RH (no condensation)


2.2 IO-Link specifications

IO-Link type	Device
IO-Link version	V1.1
Communication speed	COM2 (38.4 kbps)
Min. cycle time	2.3 ms
Process data length	Input Data: 2 byte, Output Data: 0 byte
On request data comms.	Available
Data storage function	Available
Event function	Available
Vendor ID	131 (0x0083)
Device ID	ISE79S-**-L2-* : 594 (0x0252)
Configuration file	IODD file


Special products (-X) might have specifications different from those shown in this section. Contact SMC for specific drawings.

3 Names of Individual parts

3.1 Product

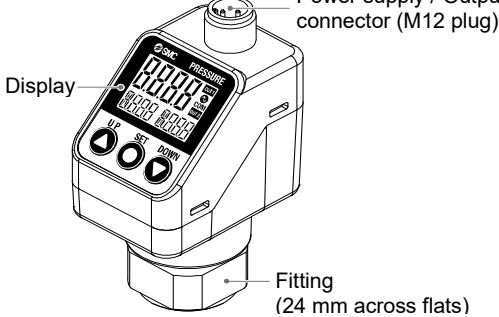

3.2 Display

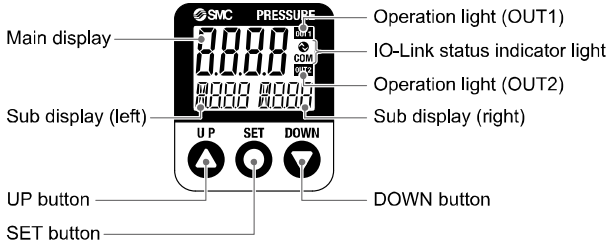

Part	Description
Operation Light	Displays the switch operating condition
Main display	Displays pressure measurement values and error codes (2 colour display).
Sub display (left)	Displays items (Orange)
Sub display (right)	Displays set values, peak and bottom values. (Orange)
UP button	Increases mode and ON/OFF set values.
DOWN button	Decreases mode and ON/OFF set values.
SET button	Changes the mode and confirms the settings.
IO-Link status indicator light	Displays OUT1 output communication status (SIO mode, start-up mode, operation mode) and the presence of communication data.

4 Installation

4.1 Installation

Warning

- Do not install the product unless the safety instructions have been read and understood.

4.2 Environment

Warning

- Do not install in a location subject to vibration or impact in excess of the product's specifications.
- Do not mount in a location exposed to radiant heat that would result in temperatures in excess of the product specification.


4.3 Mounting with Bracket

Mount the bracket to the product using mounting screws supplied (M4x6 L (2 pcs)) then set the product in the required position.

Tighten the bracket mounting screws to a torque of 0.76 \pm 0.1 N·m.

Bracket A (Part No. ZS-50-A)

Bracket B (Part No. ZS-50-B)

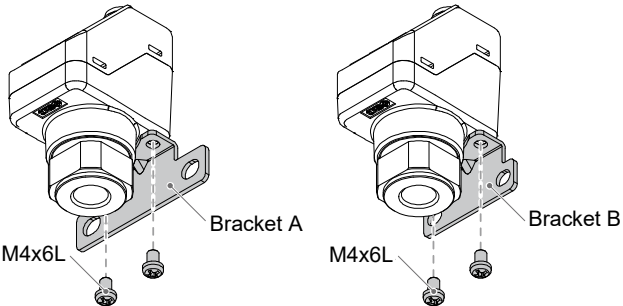


4 Installation (continued)

4.4 Piping


Caution

- Before connecting piping make sure to clean up chips, cutting oil, dust etc.
- After hand tightening, tighten the fitting using a spanner on the flat surfaces of the fitting (24 mm A/F).
- When tightening, do not hold the upper part of the product (display) with the spanner.
- The tightening torque must be 15 to 20 N·m.

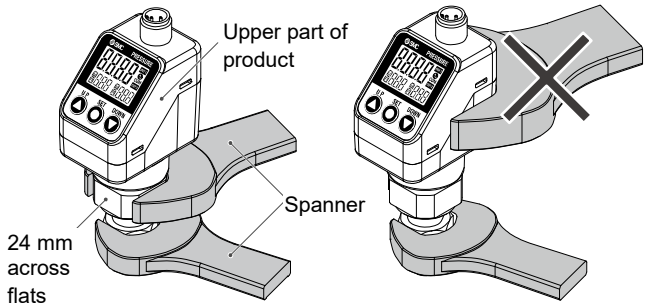

4.5 Display Rotation

- During installation, the upper part (display) of the product can be rotated by 336°. Take care as rotating the display with excessive force will damage the end stopper.




4.6 Wiring

- Connections should be made with the power supply turned off.
- Use a separate route for the product wiring and any power or high voltage wiring. Otherwise, malfunction may result due to noise.
- If a commercially available switching power supply is used, be sure to ground the frame ground (FG) terminal. If a switching power supply is connected, noise will be superimposed and will not meet the product specifications.
Insert a noise filter such as a line noise filter/ferrite between the switching power supplies or change the switching power supply to the series power supply.

4 Installation (continued)

- **How to use connector**
Align the cable connector key groove with the product connector key to insert and rotate the knurled part of the connector.
Connect the wires of the lead wire to the M12 connector as shown below.

M12 Connector (Port class A)



1) When used as a switch output device

No.	Name	Colour	Function
1	DC(+)	Brown	12 to 24 VDC
2	OUT2	White	Switch output 2
3	DC(-)	Blue	0 V
4	OUT1	Black	Switch output 1

2) When used as an IO-Link device

No.	Name	Colour	Function
1	L+	Brown	18 to 30 VDC
2	DO	White	Switch output 2
3	L-	Blue	0 V
4	C/Q	Black	Communication data (IO-Link) / Switch output 1 (SIO)



5 Setting (Measurement mode)

Power is supplied

Product code is displayed for 3 seconds

[Measurement mode]
Detects the pressure and indicates the display and switch operating status. This is the basic mode; other modes should be selected for set-point changes and other function settings.

Measurement Mode display

Current pressure value (Main display)

Item (Sub display (left))

Set value or peak/bottom value (Sub display (right))

Sub display
In measurement mode, the sub display can be temporarily changed by pressing the UP or DOWN buttons.

OUT1 set value, hysteresis, OUT2 set value, hysteresis, Bottom value, Peak value, Mode display, *: Arbitrary display

*: Arbitrary display mode can be added to the sub display by setting the [F10] sub display. If the sub display is changed during arbitrary display setting, the display will return to arbitrary display after 30 s. (The default setting does not include arbitrary display).

Press the SET button once

Press the SET button for 1 to 3 s

Press the SET button for 3 to 5 s

[3-step setting mode]
Set value or hysteresis


[Simple setting mode]
Set value, hysteresis and delay time

[Function selection mode]
Change the function settings

[Other settings]
• Zero clear
• Snap lock
• Key Lock

6 Pressure Setting

Default settings
When the pressure exceeds the set value, the switch will be turned ON. When the pressure falls below the set value by the amount of hysteresis or more, the switch will be turned OFF.
The default setting is to turn ON the pressure switch when the pressure reaches the centre of the atmospheric pressure and upper limit of the rated pressure range. If this condition is acceptable, then keep these settings.

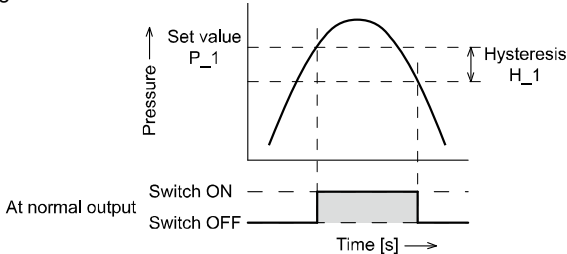

7 3-Step Setting mode

- **3-step setting mode (hysteresis mode)**
In 3-step setting mode, the set value (P_1 or n_1) and hysteresis (H_1) can be changed. Set the items on the sub display (set value or hysteresis) using the UP and DOWN button. When changing the set value, follow the operation below. The hysteresis setting can be changed in the same way.
- (1) Press the SET button once when the item to be changed is shown on the sub display. The set value on the sub display will start flashing.
 - (2) Press the UP or DOWN button to change the set value. When the UP and DOWN buttons are pressed and held simultaneously for 1 second or longer, the set value is displayed as [- -], and the set value will be the same as the current pressure value automatically (snap shot function).

- Afterwards, it is possible to adjust the value by pressing the UP or DOWN button.
- (3) Press the SET button to complete the setting.
- The Pressure switch turns on within a set pressure range (from P1L to P1H) during window comparator mode. Set P1L, the lower limit of the switch operation, and P1H, the upper limit of the switch operation and WH1 (hysteresis) following the instructions given above. (When reversed output is selected, the sub display (left) will indicate [n1L] and [n1H].)
- Set OUT2 in the same way.
 - Setting of the normal/reverse output switching and hysteresis/window comparator mode switching are performed using the function selection mode [F 1] OUT1 setting and [F 2] OUT2 setting.

8 Simple Setting mode


- (1) Press and hold the SET button between 1 and 3 seconds in measurement mode. [SEt] is displayed on the main display. When the button is released while in the [SEt] display, the current pressure value is displayed on the main display, [P_1] or [n_1] is displayed on the sub display (left), and the set value is displayed on the sub display (right) (Flashing).
- (2) Change the set value using the UP and DOWN button, and press the SET button to set the value. Then, the setting moves to hysteresis setting. (The snap shot function can be used).
- (3) Change the set value with the UP or DOWN button, and press the SET button to set the value. Then, the setting moves to the delay time of the switch output. (The snap shot function can be used).
- (4) The delay time of the switch output can be selected by pressing the UP or DOWN button at the ON and OFF point of the switch output. Delay time setting can prevent the output from chattering. The delay time can be set in the range 0.00 to 60.00 sec. in 0.01 sec. increments.

8 Simple Setting mode (continued)

- (5) Press the SET button for less than 2 seconds to complete the OUT1 setting. [P_2] or [n_2] is displayed on the sub screen (left). Continue with setting OUT2.
Press and hold the SET button for 2 seconds or longer to complete the setting. The product will return to measurement mode.
- In window comparator mode, set P1L, the lower limit of the switch operation, and P1H, the upper limit of the switch operation, WH1 (hysteresis) and dTH / dTL (delay time) following the instructions given above. (When reversed output is selected, the sub display (left) will indicate [n1L] and [n1H]).
 - Set OUT2 in the same way.

9 Function Selection mode

In measurement mode, press the SET button between 3 and 5 seconds to display [F 0]. Select to display the function to be changed [F□□]. Press and hold the SET button for 2 seconds or longer in function selection mode to return to measurement mode.

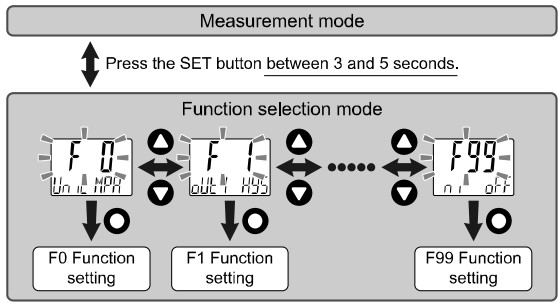

*: Some products do not have all of the functions. If a function is not available or selected due to configuration of other functions, [- -] is displayed on the sub display.

10 Other Settings

- **Peak / Bottom value display**
The max. (min.) pressure from when power is supplied is detected and monitored. The value can be displayed on the sub display by pressing the UP or DOWN button in measurement mode.
- **Snap shot function**
The current pressure value can be stored to the switch output ON/OFF set point. When the set value and hysteresis are set, press the UP and DOWN button for 1 s or longer simultaneously. Then the set value of the sub display (right) shows [---], and the values corresponding to the current pressure values are automatically displayed.
- **Zero-clear function**
In measurement mode, when the UP and DOWN buttons are pressed for 1 s or longer simultaneously, the main display shows [---] and then will reset to zero. The display will return to measurement mode automatically.
- Refer to the operation manual on the SMC website (URL: <https://www.smcworld.com>) for further details of how to set these and other functions.

11 Maintenance

11.1 General Maintenance



- Not following proper maintenance procedures could cause the product to malfunction and lead to equipment damage.
- If handled improperly, compressed air can be dangerous.
- Maintenance of pneumatic systems should be performed only by qualified personnel.
- Before performing maintenance, turn off the power supply and be sure to cut off the supply pressure. Confirm that the air is released to atmosphere.
- After installation and maintenance, apply operating pressure and power to the equipment and perform appropriate functional and leakage tests to make sure the equipment is installed correctly.

11 Maintenance (continued)

How to reset the product after power cut or forcible de-energizing
The setting of the product will be retained as it was before a power cut or de-energizing. The output condition is also basically recovered to that before a power cut or de-energizing, but may change depending on the operating environment.
Therefore, check the safety of the whole installation before operating the product. If the installation is using accurate control, wait until the product has warmed up (approximately 10 to 15 minutes).

12 Troubleshooting

12.1 Error Indication

Error	Error displayed	Description	Measures
Over current error	Er 1, Er 2	The load current applied to the switch output has exceeded the maximum value.	Turn the power off and remove the cause of the over current. Then supply the power again.
Residual pressure error	Er 3	During zero clear operation, pressure greater than ±7% F.S. is present. Note that the mode is returned to measurement mode automatically 1 s later. The zero clear range varies by ±1% F.S. due to variation between individual products.	Release the applied pressure to atmosphere, and retry the zero clear operation.
Pressurize error	HHH, LLL	Pressure exceeding the upper limit of the set pressure range is applied. Pressure exceeding the lower limit of the set pressure range is applied.	Reset applied pressure to a level within the set pressure range.
System error	Er 0, Er 4, Er 6, Er 7, Er 8, Er 9	Displayed if an internal data error has occurred.	Turn the power off and on again. If the failure cannot be solved, contact SMC.
Version does not match	Er 15	Version of master and IO-Link does not match.	Align the master IO-Link version to the device.

If the error cannot be reset after the above measures are taken, or errors other than the above are displayed, please contact SMC.

13 Limitations of Use

13.1 Limited warranty and Disclaimer/Compliance Requirements
Refer to Handling Precautions for SMC Products.

14 Product Disposal

This product shall not be disposed of as municipal waste. Check your local regulations and guidelines to dispose this product correctly, in order to reduce the impact on human health and the environment.

15 Contacts

Refer to www.smcworld.com or www.smc.eu for your local distributor / importer.

SMC Corporation

URL : <https://www.smcworld.com> (Global) <https://www.smc.eu> (Europe)
SMC Corporation, 1-5-5, Kyobashi, Chuo-ku, Tokyo 104-0031, JAPAN
Specifications are subject to change without prior notice from the manufacturer.
© SMC Corporation All Rights Reserved.
Template DKP50047-F-0850